


Conducted Emission Measurement

File :0422 Data :#1 Date: 2014-4-22 Time: 10:14:44

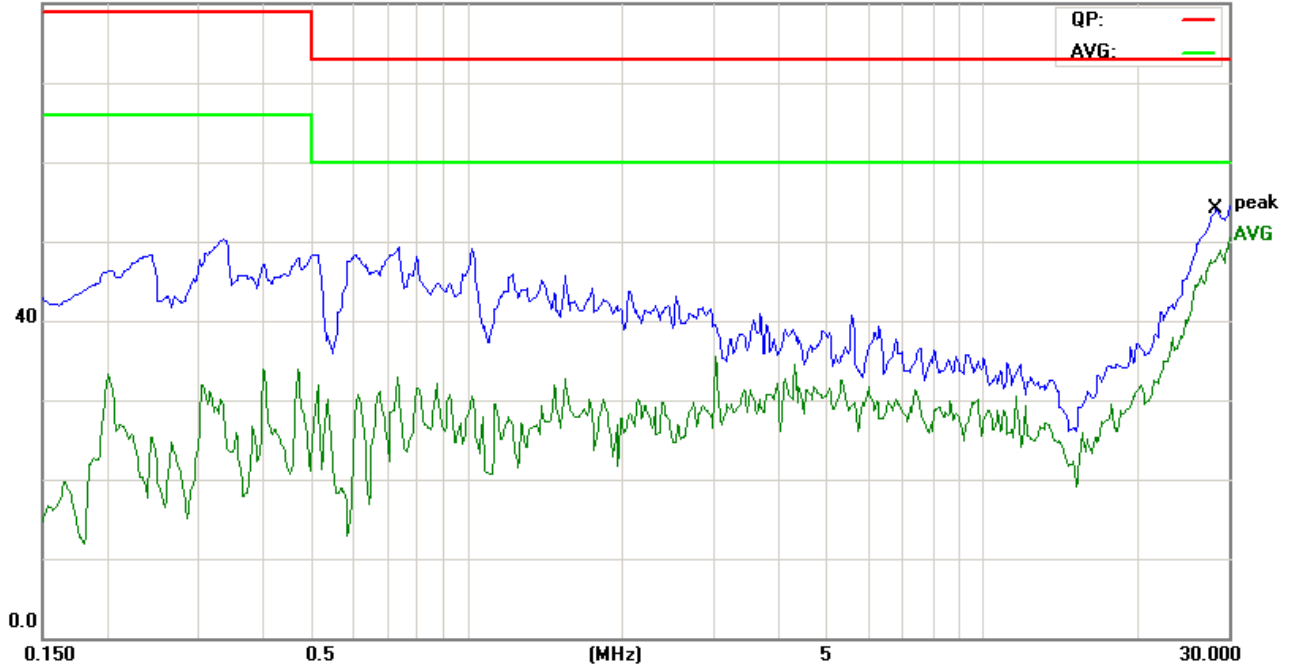


Site Chamber #1 Phase: **L1** Temperature: 26 (C)
 Limit: CISPR22 Class A Conduction(QP) Power: AC 230V/50Hz Humidity: 51 %
 EUT:
 M/N: 50W/EU Faraday Electronics
 Mode: 1#
 Note:

No.	Mk.	Freq. MHz	Reading Level dBuV	Correct Factor dB	Measure- ment dBuV	Limit dBuV	Over dB	Detector	Comment
1		28.4141	37.68	10.80	48.48	73.00	-24.52	QP	
2	*	28.4141	32.26	10.80	43.06	60.00	-16.94	AVG	

*:Maximum data x:Over limit !:over margin

Conducted Emission Measurement

File :0422 Data :#3 Date: 2014-4-22 Time: 10:18:11

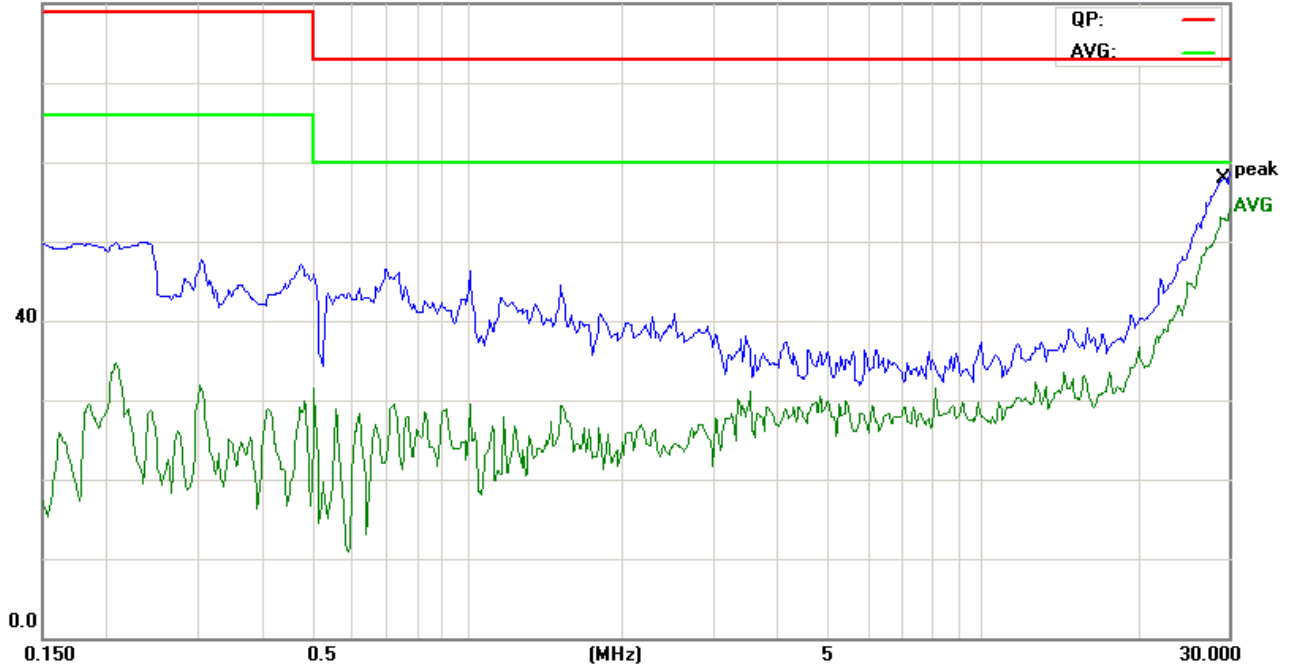

Site Chamber #1 Phase: **N** Temperature: 26 (C)
 Limit: CISPR22 Class A Conduction(QP) Power: AC 230V/50Hz Humidity: 51 %
 EUT:
 M/N: 50W/EU Faraday Electronics
 Mode: 2#
 Note:

No.	Mk.	Freq. MHz	Reading Level dBuV	Correct Factor dB	Measure- ment dBuV	Limit dBuV	Over dB	Detector	Comment
1		29.3594	41.88	10.91	52.79	73.00	-20.21	QP	
2	*	29.3594	34.39	10.91	45.30	60.00	-14.70	AVG	

*:Maximum data x:Over limit !:over margin